

Page 1 of 25 GSCC020 Rev. 00

07/2019

## INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV.

Countries I8	<sup>k</sup> N
Argentina	C. Espinoza
Brazil	R. Sales
Chile	D. Gonzalez
Colombia	J. C. Gomez
Italy	L. Giansante
Peru	R. Sanchez
Romania	V. Obrejan
Spain	J. Gonzalez

	Elaborated by	Verified by	Approved by
Global I&N – O&M/NCS	Filippo Gentili	Jean Goossens	Maurizio Mazzotti

This document is intellectual property of ENEL Group distribution companies; reproduction or distribution of its contents in any way or by any means whatsoever is subject to the prior approval of the above mentioned companies which will safeguard their rights under the civil and penal codes. This document is for Internal Use.

Revision	Data	List of modifications
0	22/07/2019	First Edition



## Index

1	Sco	ре	3
2	Field	d of Application	3
3	Rep	laced Local Standards	3
4	Refe	erence laws and standards	4
4	4.1	Laws	4
4	1.2	Standards	5
5	Туре	es of IPC and cables	5
Ę	5.1	Local Cables specification 1	1
6	Des	ign and Construction 1	2
(	6.1	General requirements 1	2
(	6.2	Body1	3
(	6.3	Electrical contacts 1	3
(	6.4	Fitting system1	4
(	6.5	Fuses for type B connectors	4
7	Test	ts 1	5
-	7.1	Routine test1	5
-	7.2	Sample test 1	5
-	7.3	Type Test1	6
-	7.4	Sampling1	7
-	7.5	Acceptance Criteria 1	8
8	Con	ditions of supply1	9
8	3.1	Marking 1	9
8	3.2	Packing 1	9
Ch	ecklist		0

	GLOBAL STANDARD	Page 3 of 25
enel	INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV	GSCC020 Rev. 00 07/2019

#### 1 Scope

The scope of this global standard is to provide technical requirements for insulation piercing connectors for aerial application to be used in the distribution networks of Enel Group listed below:

Enel Codensa	Colombia
Edesur	Argentina
e-distributie Banat	Romania
e-distributie Dobrogea	Romania
e-distributie Muntenia	Romania
e-distribuzione	Italy
Endesa Distribución Eléctrica	Spain
Enel Distribución Chile	Chile
Enel Distribución Perú	Perú
Enel Distribuição Ceará	Brazil
Enel Distribuição Goiás	Brazil
Enel Distribuição Rio	Brazil
Enel Distribuição São Paulo	Brazil

#### 2 Field of Application

This standard covers the design, manufacture, testing and supply of insulation piercing connectors (IPC) for making connections to aerial bundled cables (ABC) or aerial-insulated cables (AIC) with rated voltage Uo/U (Umax) = 0.6/1.0(1.2) kV.

#### 3 Replaced Local Standards

This standard replaces all the local standards used up to now by all the Distribution Companies.

- **Codensa:** ET 306
- Edesur: DBEE06
- e-distributie Banat, Dobrogea and Muntenia: DM 6050 RO
- e-distribuzione: DM 6050
- Enel Distribuição São Paulo: NTE-8445 e NTE-M-021
- Endesa Distribución Eléctrica: 6700129, 6700130, 6700131, 6700132
- Enel Distribución Chile: DMC-0009, DMC-0016
- Enel Distribución Perú: DNN-ET-084 and LE-1-340-1
- Enel Distribuição Ceará, Enel Distribuição Goiás and Enel Distribuição Rio: PM-Br-710.53.0



#### 4 **Reference laws and standards**

#### 4.1 Laws

#### Codensa:

• RETIE, Reglamento técnico de Instalaciones Eléctricas.

#### Edesur:

- Reglamentación AEA 95150 "Instalaciones Eléctricas de Suministro y Medición en Baja Tensión". •
- Reglamentación AEA 95201 "Líneas Eléctricas Exteriores de Baja Tensión". •

#### e-distributie Banat, Dobrogea, Muntenia:

• PE 106 / 2003 Normativ pentru proiectarea si executarea liniilor electrice aeriene de joasă tensiune

#### Enel Distribuição São Paulo:

NR-10 – Segurança em instalações e serviços em eletricidade. •

#### Endesa Distribución Eléctrica:

R.D 842/2002, de 2 de agosto, por el que aprueba el Reglamento Electrotécnico para Baja tensión. •

#### Enel Distribución Chile:

• NCH Elec 4/2003 – Instalaciones de consumo en baja tensión.

#### Enel Distribución Perú:

- Código Nacional de Electricidad Suministros 2011. ٠
- Norma Técnica de Calidad de los servicios eléctricos (NTCSE) •

#### Enel Distribuição Ceará:

NR-10 – Segurança em instalações e serviços em eletricidade. •

#### Enel Distribuição Goiás:

• NR-10 – Segurança em instalações e serviços em eletricidade.

#### Enel Distribuição Rio:

• NR-10 – Segurança em instalações e serviços em eletricidade.

FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

Rev. 00

07/2019

#### 4.2 Standards

The below-listed reference documents shall be intended in the in-force edition at the contract date (amendments included). Unless otherwise specified, these documents are valid until the new versions replace them.

- EN 50483-1 Test requirements for low voltage aerial bundled cable accessories Part 1: Generalities
- EN 50483-4 Test requirements for low voltage aerial bundled cable accessories Part 4: Connectors
- EN 50483-5 Test requirements for low voltage aerial bundled cable accessories Part 5: Electrical ageing test
- EN 50483-6 Test requirements for low voltage aerial bundled cable accessories Part 6: Environmental testing

#### 5 Types of IPC and cables

The IPC'S specified in this global standard shall be suitable for installation in low voltage aerial bundled cables or concentric cables (after peeling) with aluminum and copper conductors indicated in standards GSCC009 and some local standards indicated in 5.1

The following types of IPC are defined:

- Type A: "Single-phase insulation piercing connector."
- Type B: "Single phase insulation piercing connector IPC with fuse holder or copper rod."
- Type C: "Multi-tap insulation piercing connector with 4 outgoing branch circuits."

Not bidding construction designs are shown in the following figures.


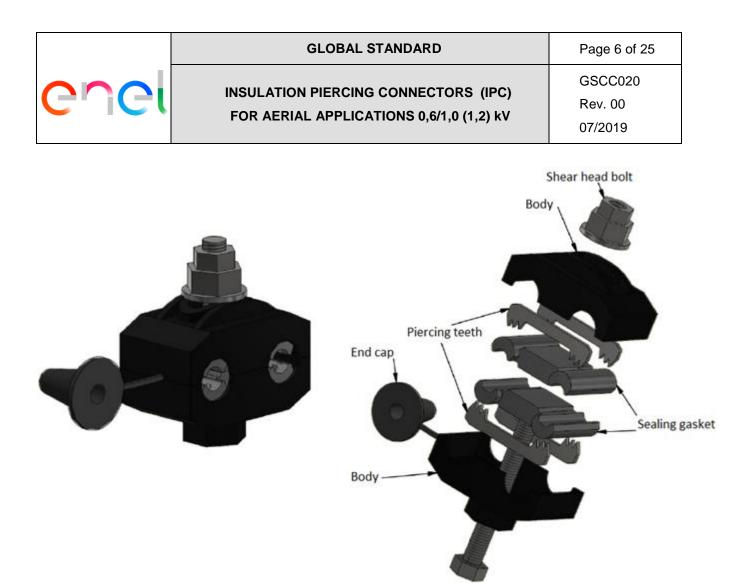


Figure 1 Type A Insulation piercing connector



Page 7 of 25 GSCC020 Rev. 00 07/2019

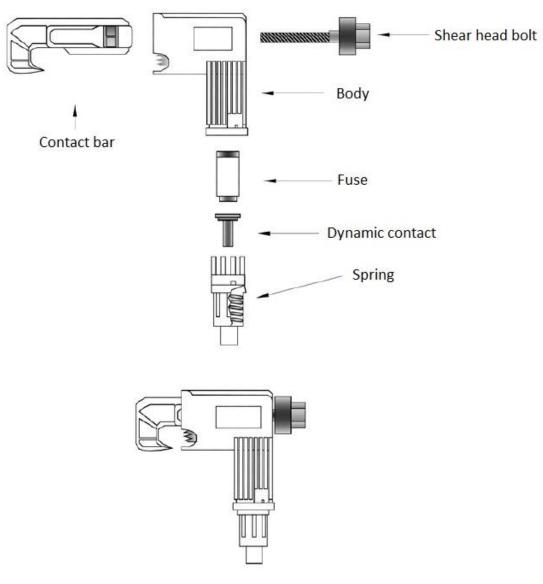


Figure 2 Type B insulation piercing connector



# GLOBAL STANDARD INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

Page 8 of 25 GSCC020 Rev. 00 07/2019

Contact teeth Contact teeth Switchable contact with spring and fuse

Figure 3 Type B insulation piercing connector

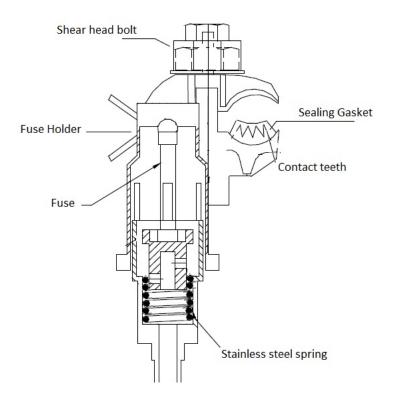


Figure 4 Type B insulation piercing connector



# **INSULATION PIERCING CONNECTORS (IPC)** FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

**GLOBAL STANDARD** 

Page 9 of 25 GSCC020

Rev. 00

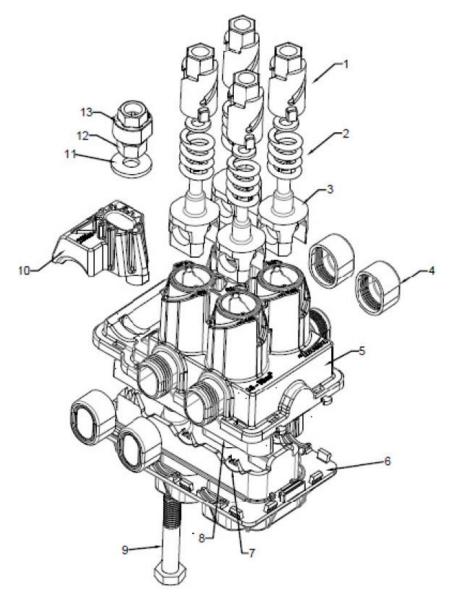


Figure 5 Type C insulation piercing connector

- 1. 2. 3. 4. 5. Nylon screw
- Stainless Steel Spring
- Nylon guide Elastomer cap
- Nylon body
- Nylon Base
- 6. 7. Copper toothed contact

- 8. Elastomer Sealer 9.
  - Sext Screw M8X1,25 Zinc Plated
- 10. Nylon cover
- Galvanized flat washer 11.
- M8 nut zinc plated 12.
- 13. Zamak nut limiter



Page 10 of 25

## INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

GSCC020 Rev. 00

Country Code	Type Code	Country	IPC Type	Main cable	Branch cable
0115-0307	0000000//	AR	Time D	10.05	4.05
270030	GSCC020/1	CL	Туре В	10-95	4-35
0115-0306		AR			
329753	0000000/0	BR-SP	- ·	05.05	05.05
271397	GSCC020/2	CL	Туре А	25-95	25-95
273992		PE			
T270464		BR (RJ/CE/GO)			
329761	GSCC020/3	BR-SP	Туре А	35-150	35-150
271398		CL			
0115-0459		AR			
T270465		BR (RJ/CE/GO)			
271403	GSCC020/4	CL	Туре А	16-95	4-35
251379		со			
160854		ES			
273938		PE			
T270466	GSCC020/5	BR (RJ/CE/GO)	Туре А	50-150	6-54.6
270730		ES			
273937	GSCC020/6	PE	Туре А	16-95	1,5-6 (**)
075004	000000/7*	IT		05 70	0.54.0
275001	GSCC020/7*	RO	Туре А	35-70	6-54.6
275002		IT		10.16	6.46
275003	GSCC020/8*	RO	Туре А	10-16	6-16
329318	GSCC020/9	BR-SP	Туре С	50-150	2,5-35



# INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

**GLOBAL STANDARD** 

Page 11 of 25 GSCC020 Rev. 00 07/2019

329762	GSCC020/10	BR-SP	Туре А	50-120	185-240
329764	GSCC020/11	BR-SP	Туре А	6-35	6-35
T270467	GSCC020/12	BR (RJ/CE/GO)	Туре А	16-150	1.5-6
T270468	GSCC020/13	BR (RJ/CE/GO)	Туре А	25-120	25-120
329752	050000/14			10-70	50 120
GSCC020/14 BR-SP 329754		Туре А	10-70	50-120	
(*) IPC for Type III and Type IV cables with insulation and sheath from Global standard GSCC009					

(\*\*) "Single teeth" piercing system shall be used.

Table 1

#### 5.1 Local Cables specification

The cables indicated in the following local specifications can be used in the IPC'S specified in this global standard.

- Latam: E-BT-003
- Argentina: DBEE04, DBEE03, DBEE13

#### 6 **Design and Construction**

#### 6.1 General requirements

The IPC shall be designed to perform connections between the main cable and a single (or several in case of Type C IPC) branch cables without removing the insulation or outer sheath (if any). The IPC shall first pierce the outer sheath (if any) and the insulation, then make good electrical contact between the main and the branched conductors while simultaneously insulating and sealing the connection. Only when installed on concentric neutral cables cable preparation shall be done.

The IPC shall be Class 1 according to EN 50483-4 clause 8.1.3.1. The water tightness shall be ensured by appropriate sealing gasket around the teeth made of flexible insulating material and not by grease, gel or paste alone. Such sealing shall be designed appropriately to avoid damage to conductor insulation beyond the piercing point.

The IPC shall be supplied with removable branch cable end caps, which avoid accidental contact with the live part of the branch cable by sealing its cut end. It shall be possible to install from both sides of the connector, with the connector being in its vertical position with the bolt head upwards. The end cap shall be rigid of slide type enabling easy positioning and unloadable after the tap cable is positioned and shall be equipped with a water tightness seal.

Applying grease to protect the contact teeth is allowed as long as it is not visible from the outside of the IPC, in other words, the IPC shall not be dipped in grease. In addition, such grease shall be compatible with the sealing gasket material and shall maintain all its features over time.

The IPC surface shall be smooth and uniform without sharp edges or burrs. Also, it shall be free from all flaws and suitably rounded off. It is thus avoiding damage to the insulation of adjacent cables due to vibration or r movement during operation.

The dropping point of the grease used for protection of the contact teeth or to seal the cap shall be 160 °C according to standard ISO 2176 or ASTM D 566.

The installation of the connector shall be made using a single wrench.

The outgoing circuits from the multi-tap Type C IPC shall be independently and individually connectable/ disconnectable without disturbing the connection to the main cable or branches, by means of bolts with a semirotary system, spring system, with insulating perforation contacts. Also shall contemplate the temporary earth connection point with the bracket or the installation of the pin.

For Type A and Type B IPC's the piercing shall be performed using single bolt for tightening All the metallic elements not considered herein shall be made of stainless steel (AISI 316).

The IPC shall guarantee ingress protection marking at least the same as:

- IP 2X before tightening operation.
- IP4X after tightening operation.

#### 6.2 Body

The body of the IPC shall be made completely of mechanical and weather resistant insulating material with no metallic parts outside the housing, except for the tightening bolt, that in any case, will be insulated at all times from the parties.

The IPC body shall be designed to be stressed exclusively to compression at the time of the tightening operation, maintaining its mechanical characteristics unchanged over time.

A self-extinguish thermoplastic polyester shall be used.

As soon as the sheared-bolt breaks, all the parts of the IPC body shall be stressed to actions less than the elastic or breaking limits of the insulating material.

The insulating material shall be able to withstand the expected mechanical and thermal efforts during operation a range of temperatures from -10°C to 50°C and cables operating at 90 °C during continuums operation and 250 °C during short circuit.

The insulating material shall be UV stabilized and shall satisfy the following requirement

Water adsorption test (according to ISO 62 or ASTM d 570), measured on a 50x50x3,2 mm sample. The result of the test shall be less than 0,2% after 24 h of immersion in water at 23 °C and not more than 1% unsaturation conditions.

#### 6.3 Electrical contacts

The piercing teeth shall be made of tinned copper or tinned copper alloy with Brinell hardness greater than 100 HB. The minimum thickness of the tinning shall be at least 8 µm.

When the material used is Copper alloy, it shall have a sufficient percentage of Copper so that it does not deteriorate due to corrosion. This percentage will not be less than 58%.

The connectors maximum contact resistance (between the piercing teeth and the cable conductor) shall be designed to be not greater than 30  $\mu\Omega$ . In addition, after performing the thermal tests, such value cannot be greater than 40  $\mu\Omega$ .

For type A connectors the piercing system shall be "double teeth" enough to guarantee property connection according to types of conductors defined in section 5. Unless otherwise stated in table 1, for small section conductors in such case, the "Single teeth" piercing system shall be used.

For type B connectors the contact of the fuse holder with the connector shall be a tinned copper bar with a diameter of not less than 6 mm and the upper contact of the fuse holder shall be connected to the teeth penetrating the cable and shall be in contact with the larger diameter end of the fuse or equivalent (see section 6.5)

#### 6.4 Fitting system

The fitting of the IPC shall be performed with torque limiting screw with shear head to prevent over tightening or under tightening.

Minimum and Maximum torque values at 25 °C shall be clearly specified by the manufacturer and shall not exceed:

- 20 Nm for IPC for main conductor ≤95 mm<sup>2</sup>
- 30 Nm for IPC for main conductor between 95 mm<sup>2</sup> and 150 mm<sup>2</sup>.

In addition, the manufacturer shall specify the minimum and maximum torque values at -10 °C and 50 °C.

The tightening screw and the shear head bolt shall have hexagonal heads. When several bolts are to be tightened, they shall have the same dimensions.

When the bolt head breaks, it shall be impossible to apply additional tightening torque, but still, disassembling operation of the IPC shall be possible, obtaining access to both main and branch cables.

The screws, nuts and washers shall be made of "austenitic" stainless steel (AISI 316).

For type B connectors, the adjustment system for the fuse holder will be bayonet connector type and shall ensure permanent contact pressure under all load conditions and permissible temperatures.

#### 6.5 Fuses for type B connectors.

Argentina:

The fuses for the type B connectors shall be NEOZED fuse system indicated in standards ETGCC N° 657 Rev. 1.

Chile:

Instead of a fuse, a device of equal size will be used for grants the electrical conduction (cooper road) and another that interrupting the supply (insulating fittings) that will enable the connection and disconnection of the load connected to the IPC.



GLOBAL STANDARD	Page 15 of 25
INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV	GSCC020 Rev. 00
	07/2019

## 7 Tests

#### 7.1 Routine test

N°	Test	Test Method and Requirement
1	Visual examination	See Clause 6
2	Dimensional and material verification	See Clause 6

Table 2 Routine test

## 7.2 Sample test

N°	Test	Test Method and Requirement
1	Visual examination	(See Clause 6)
	Dimensional and material verification	(See Clause 6)
	IPC body material	- Self-extinguish thermoplastic polyester and resistant to UV radiation.
2	Material of the screws, nuts, and washers.	- Austenitic stainless steel (AISI 316).
	Tinning thickness measurement	- Thickness of the tinning > 8 $\mu$ m
	measurement	- Measurement: Brinell hardness > 100 HB
3	Test for mechanical damage to conductors	§8.1.2.1 Standard EN 50483-4
4	Branch cable pull-out test	§8.1.2.2 Standard EN 50483-4
5	Bolt tightening test	§8.1.2.3 Standard EN 50483-4
6	Dielectrical voltage test	§8.1.3.1.3.1 Standard EN 50483-4 applying 6 kV
7	Test for permanent marking	§9.2 Standard EN 50483-1
8	Low temperature assembly test	§8.1.4 Standard EN 50483-4
9	Shear head function test	§8.1.2.4 Standard EN 50483-4

Table 3 Sample test



Rev. 00 07/2019

#### Type Test 7.3

The samples required should correspond to Table B.5 of Annex B of EN50483-1.

1	Visual examination	
		See Clause 6
2	Dimensional and material verification	See Clause 6
3	Test for mechanical damage to the main conductor.	§8.1.2.1 Standard EN 50483-4
4	Branch cable pull-out test	§8.1.2.2 Standard EN 50483-4
5	Connector bolt tightening test	§8.1.2.3 Standard EN 50483-4
6	Shear head function test	§8.1.2.4 Standard EN 50483-4
7	Low temperature impact test	§8.1.2.5 Standard EN 50483-4
8	Dielectrical voltage test and water tightening test	§8.1.3.1.3.1 Standard EN 50483-4 applying 6 kV a.c for class 1
9	Low temperature assembly test	§8.1.4 Standard EN 50483-4
	Corrosion tests	§8.1.5.1 Standard EN 50483-4
10	Salt mist test	§8.1.5.1.3.1 from Standard EN 50483-4
10	Gas Atmosphere test	§8.1.5.1.3.2 Method 2 from standard EN 50483-4
	Immersion test	§8.1.5.1.3.3 Method 1 from standard EN 50483-4
11	Climatic ageing test	Method 1 §8.1.5.2.3.1 Standard EN 50483-4
12	Test for permanent marking	§9.2 Standard EN 50483-1
13	Electrical ageing test	§8.1.6 Standard EN 50483-4 for Class A IPC considering values of sub-clauses 6.2 and 6.3 herein.
14	Determination of dropping point	Greater than 160 °C according to standard ISO 2176 or ASTM D 566
15	IP degree	IEC 60529
16	Tinning thickness measurement	Measurement: Brinell hardness > 100 HB and thickness of the tinning > 8 $\mu$ m.



Rev. 00 07/2019

#### 7.4 Sampling

In order to determine the acceptability of a lot, the prescriptions indicated in the table below shall be used.

The costs of rejected materials and the samples will be charged to the bidder.

Lot size (N)	F	irst Samp	le	Second Sample			
	n <sub>1</sub>	NA <sub>1</sub>	NR <sub>1</sub>	n <sub>2</sub>	NA <sub>2</sub>	NR <sub>2</sub>	
N≤10.000	10	0	2	20	1	2	
10.000 <n≤30.000< th=""><th>20</th><th>0</th><th>2</th><th>20</th><th>2</th><th>3</th></n≤30.000<>	20	0	2	20	2	3	
N>30.000	32	1	3	32	2	3	

Table 5 Samples and Grade of Acceptance to Each of the Trials

Where:

n1: First sample size

NA1: First acceptance number

NR1: First rejection number

n<sub>2</sub>: Second sample size

NA2: Second acceptance number

NR<sub>2</sub>: Second rejection number

The acceptance criteria will be:

- If the number of nonconforming units found in the first sample (n<sub>d1</sub>) is equal to or less than the first acceptance number (NA<sub>1</sub>), the lot shall be considered acceptable.
- If the number of nonconforming units (nd1) found in the first sample is equal to or greater than the first rejection number (NR1), the lot shall be considered not acceptable.
- If the number of nonconforming units found in the first sample is between the first acceptance and rejection numbers (NA<sub>1</sub>< n<sub>d1</sub>< NR<sub>1</sub>), a second sample of the size given by the plan shall be inspected.
- The number of nonconforming units found in the first and second samples shall be accumulated (n<sub>d</sub>= n<sub>d1</sub> +n<sub>d2</sub>).

- If the cumulative number of nonconforming units (n<sub>d</sub>) is equal to or less than the second acceptance number (NA<sub>2</sub>), the lot shall be considered acceptable.
- If the cumulative number of nonconforming units (n<sub>d</sub>) is equal to or greater than the second rejection number (NR<sub>2</sub>), the lot shall be considered not acceptable.

#### 7.5 Acceptance Criteria

The routine tests shall be performed at 100% of delivered IPC's.

Tests performed during the production process on semi-finished products may also be considered valid, as acceptance test, if:

- the tests are performed as required by the relevant technical specifications and technical standards;
- the sampling plans adopted by the Supplier are in compliance with the aforementioned ones;
- the performed test results are properly recorded;
- the Supplier demonstrates that the components/materials features do not vary during further production phases after the test.

The reports of the acceptance tests performed by the Supplier shall be prepared and retained, for possible verification by Enel inspectors.

The Supplier shall be available to repeat the tests in the presence of Enel's Inspector, on a "reduced" sample of the supply lot, defined as follows:

- Routine test: the minimum between a single sampling plan for normal inspection, AQL=1%, Level I, and 1/3 of the total number of delivered IPC's.
- Sample test: 1/2 of the sampling (rounded down to the nearest unit) already adopted for the sample test independently performed by the supplier (Enel inspector can choose to perform the test in lots already tested by the Supplier or on others from the lot).

The negative result of a single test will result in the rejection of the lot or, when possible, in the repetition of the test on all the units, in order to accept only the compliant ones

	GLOBAL STANDARD	Page 19 of 25	
enel	INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV	GSCC020 Rev. 00 07/2019	

#### 8 Conditions of supply

Manufacturers of IPC's connectors shall provide appropriate instructions, and information covering general conditions during transport, storage and installation of the connectors. The documents shall be in the local language of the destination country.

#### 8.1 Marking

The IPC shall contain the following information:

- Manufacturer's trademark or logo
- Enel country code and Type code
- the minimum and maximum cross section for which the unit is suitable
- Date of Manufacture.
- Tightening torque.

#### 8.2 Packing

Each connector will be delivered complete and assembled in individual bags hermetically sealed. Each bag will be printed with the following information:

- manufacturer's trademark or logo;
- Enel country code and Type code
- product code or reference;
- traceability code / batch number;
- the minimum and maximum cross section for which the unit is suitable;
- Tightening torque.
- Date of Manufacture.



#### Checklist

## For Type A IPC

Item	Description	Unit	Required	Offered
1	GENERAL INFORMATION			
1.1	Supplier	-	Informative	
1.2	Factory	-	Informative	
1.3	Product code or reference of manufacturer	-	Informative	
2	MAIN FEATURES			
2.1	Distribution Company and Country	-	Informative	
2.2	Country Code	-	according to table 1 (e.g.): 271387	
2.3	GS Type Code	-	according to table 1 (e.g.): GSCC020/2	
2.4	Type IPC	-	A	
3	ELECTRICAL FEATURES			
3.1	Rated voltage (Un)	[kV]	0.6/1(12)	
3.2	Rated current (InA)	[A]	Informative	
3.3	Dielectrical Voltage test in water	kV	6	
3.4	Connectors contact resistance (before performing the thermal tests)	μΩ	30	
3.5	Connectors contact resistance (after performing the thermal tests)	μΩ	<40	
4	MECHANICAL FEATURES			
4.1	IPC body material	-	self-extinguish thermoplastic polyester and resistant to UV radiation	
4.2.1	Minimum and maximum cross-section for the main cable	mm²	(e.g.): 25-95	
4.2.2	Minimum and maximum cross-section for the branch cable	mm²	(e.g.): 25-95	



INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV GSCC020

Page 21 of 25

Rev. 00

4.3.1	Maximum tightening torque at 25 °C.	Nm	Do not exceed: - 20 Nm for IPC for main conductor ≤95 mm2 - 30 Nm for IPC for main conductor between 95 mm2 and 150 mm2.
4.3.2	The minimum and maximum torque values at -10 °C and 50 °C.	NM	Informative
4.4	Determination of dropping point	°C	160.
4.5.1	Ingress protection marking guaranteed (IP) (before Installation)	-	IP2X.
4.5.2	Ingress protection marking guaranteed (IP) (after Installation)	-	IP4X.
4.6.1	Piercing system ("Single teeth" or "double teeth")	-	"Single teeth system" only for GSCC020/6.
4.6.2	Material of the piercing teeth	-	Tinned copper or tinned copper alloy
4.7.1	Tinning thickness measurement (hardness)	HB	>100 HB
4.7.2	Tinning thickness measurement (thickness of the tinning)	μm	> 8 µm.
4.8.1	Material of the screws, nuts, and washers.	-	"Austenitic" stainless steel. (AISI 316)
4.8.2	Type of construction tightening nut	-	Torque limiting screw with shear head
4.8.3	Hexagonal heads for the tightening screw and the shear head bolt	-	Yes
4.9	Tightness Test	-	Class 1 (according to section 8.1.3.1 EN-50483-4)
5	Dimensions		
5.1	Height	(cm)	Informative
5.2	Width	(cm)	Informative
5.3	Length	(cm)	Informative
5.4	weight	(gr)	Informative



GSCC020

Rev. 00

07/2019

## For Type B IPC

Item	Description	Unit	Required	Offered
1	GENERAL INFORMATION			
1.1	Supplier	-	Informative	
1.2	Factory	-	Informative	
1.3	Product code or reference of manufacturer	-	Informative	
2	MAIN FEATURES			
2.1	Distribution Company and Country	-	Informative	
2.2	Country Code	-	according to table 1 (e.g.): 0115-0307	
2.3	GS Type Code	-	according to table 1 (e.g.): GSCC020/1	
2.4	Туре ІРС	-	В	
2.5	Type of fuse for use in IPC type B		NEOZED (Argentina) or Conductive Piece (Chile) (according to section 6.5)	
3	ELECTRICAL FEATURES			
3.1	Rated voltage (Un)	[kV]	0.6/1(12)	
3.2	Rated current (InA)	[A]	Informative	
3.3	Dielectrical Voltage test in water	kV	6	
3.4	Connectors contact resistance (before performing the thermal tests)	μΩ	30	
3.5	Connectors contact resistance (after performing the thermal tests)	μΩ	<40	
4	MECHANICAL FEATURES			
4.1	IPC body material	-	self-extinguish thermoplastic polyester and resistant to UV radiation	
4.2.1	Minimum and maximum cross-section for the main cable	mm²	(e.g.): 25-95	
4.2.2	Minimum and maximum cross-section for the branch cable	mm²	(e.g.): 25-95	



Page 23 of 25

## INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

GSCC020

Rev. 00

4.3.1	Maximum tightening torque at 25 °C.	Nm	Do not exceed: - 20 Nm for IPC for main conductor ≤95 mm2 - 30 Nm for IPC for main conductor between 95 mm2 and 150 mm2.
4.3.2	The minimum and maximum torque values at -10 °C and 50 °C.	NM	Informative
4.4	Determination of dropping point	°C	160.
4.5.1	Ingress protection marking guaranteed (IP) (before Installation)	-	IP2X.
4.5.2	Ingress protection marking guaranteed (IP) (after Installation)	-	IP4X.
4.6.1	Material of the piercing teeth	-	Tinned copper.
4.6.2	Material of the contact of the fuse holder with the connector	-	Tinned copper.
4.6.3	Diameter of the contact of the fuse holder with the connector	mm	>6 mm
4.7.1	Tinning thickness measurement (hardness)	НВ	>100 HB
4.7.2	Tinning thickness measurement (thickness of the tinning)	μm	> 8 µm.
4.8.1	Material of the screws, nuts, and washers.	-	"Austenitic" stainless steel. (AISI 316)
4.8.2	Type of construction tightening nut	-	Torque limiting screw with shear head
4.8.3	Hexagonal heads for the tightening screw and the shear head bolt	-	Yes
4.9	Tightness Test	-	Class 1 (according to section 8.1.3.1 EN-50483-4)
5	Dimensions		
5.1	Height	(cm)	Informative
5.2	Width	(cm)	Informative
5.3	Length	(cm)	Informative
5.4	weight	(gr)	Informative



## For Type C IPC

Item	Description	Unit	Required	Offered
1	GENERAL INFORMATION			
1.1	Supplier	-	Informative	
1.2	Factory	-	Informative	
1.3	Product code or reference of manufacturer	-	Informative	
2	MAIN FEATURES			
2.1	Distribution Company and Country	-	Informative	
2.2	Country Code	-	according to table 1 (e.g.): 329318	
2.3	GS Type Code	-	according to table 1 (e.g.): GSCC020/9	
2.4	Type IPC	-	С	
3	ELECTRICAL FEATURES			
3.1	Rated voltage (Un)	[kV]	0.6/1(12)	
3.2	Rated current (InA)	[A]	Informative	
3.3	Dielectrical Voltage test in water	kV	6	
3.4	Connectors contact resistance (before performing the thermal tests)	μΩ	30	
3.5	Connectors contact resistance (after performing the thermal tests)	μΩ	<40	
4	MECHANICAL FEATURES			
4.1	IPC body material	-	self-extinguish thermoplastic polyester and resistant to UV radiation	
4.2.1	Minimum and maximum cross-section for the main cable	mm²	(e.g.): 25-95	
4.2.2	Minimum and maximum cross-section for the branch cable	mm²	(e.g.): 25-95	



Page 25 of 25

## INSULATION PIERCING CONNECTORS (IPC) FOR AERIAL APPLICATIONS 0,6/1,0 (1,2) kV

GSCC020

Rev. 00

4.3.1	Maximum tightening torque at 25 °C.	Nm	Do not exceed: - 20 Nm for IPC for main conductor ≤95 mm2 - 30 Nm for IPC for main conductor between 95 mm2 and 150 mm2.	
4.3.2	The minimum and maximum torque values at -10 °C and 50 °C.	NM	Informative	
4.4	Determination of dropping point	°C	160.	
4.5.1	Ingress protection marking guaranteed (IP) (before Installation)	-	IP2X.	
4.5.2	Ingress protection marking guaranteed (IP) (after Installation)	-	IP4X.	
4.6	Material of the piercing teeth	-	Tinned copper or tinned copper alloy	
4.7.1	Tinning thickness measurement (hardness)	HB	>100 HB	
4.7.2	Tinning thickness measurement (thickness of the tinning)	μm	> 8 µm.	
4.8.1	Material of the screws, nuts, and washers.	-	"Austenitic" stainless steel. (AISI 316)	
4.8.2	Type of construction tightening nut	-	Torque limiting screw with shear head	
4.8.3	Hexagonal heads for the tightening screw and the shear head bolt	-	Yes	
4.9	Tightness Test	-	Class 1 (according to section 8.1.3.1 EN-50483-4)	
5	Dimensions			
5.1	Height	(cm)	Informative	
5.2	Width	(cm)	Informative	
5.3	Length	(cm)	Informative	
5.4	weight	(gr)	Informative	